



**PAVUS, a.s.**

**Order No.:**

Z220180153/O

## **ASSESSMENT OF THE FIRE TECHNICAL PROPERTIES**

for product

### **STAVOBLOCK FASÁDA (on metal construction)**

**Sponsor:** STAVOBLOCK system, s.r.o.  
Lezník 133  
572 01 Polička  
Czech Republic

The assessment contains 4 pages.

**Copies in total:** 3  
**Copy number:** 1

Other components of the system:

- wall plugs Mungo;
- Termostop;

are included in a small amount and do not affect the total reaction to fire classification of the assessed product STAVOBLOCK FASÁDA.

## 5 CONCLUSION

---

Reaction to fire class is determined on the basis of evaluation of the assessed system STAVOBLOCK FASÁDA (description is given in chap. 2 of this document):

**A1**

Other mineral insulations with the same reaction to fire class A1 may be used instead of the assessed mineral thermal insulation ROTAFLEX Super FD 01 in the structure of the system STAVOBLOCK FASÁDA.

## 6 VALIDITY OF THE ASSESSMENT

---

The validity of this assessment is until **2021-05-04**.

This Assessment is valid, if the documents, given in chap. 3, that are used in support of this document are kept valid.

This Assessment of the fire technical properties supersedes and cancels the Assessment of the fire technical properties, order No. Z220180153 (see [5], chap. 3 of this document).

*The assessment is valid only as a whole and each page shall have the order number and the page number of the total number of pages. This assessment replaces neither the type approval nor the product certificate.*

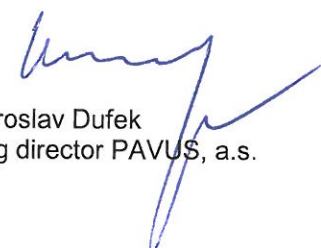
Prepared by:

  
Jaroslav Kopečný

Reviewed by:

  
Jana Buchtová

Approved by:

  
Jaroslav Dufek  
Managing director PAVUS, a.s.

Prague, 2018-05-23

